


PLAN VIEW

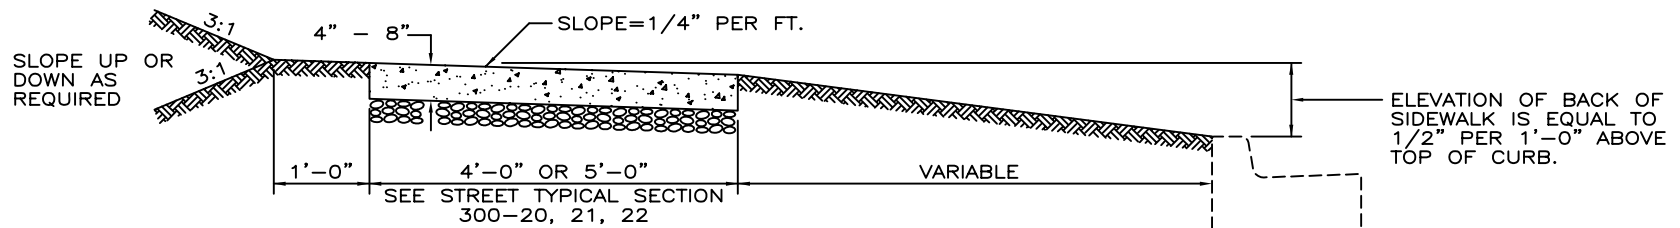

SECTION A-A

GENERAL NOTES:

1. PROVIDE BROOM FINISH TO ALL EXPOSED SURFACES (PER DRAWING 300-23).
2. CONCRETE SHALL BE ODOT CLASS "C".
3. PROVIDE A MINIMUM OF 2" EDGING AROUND ALL EXPOSED SURFACES.
4. EXPANSION MATERIAL MUST BE SECURED IN PLACE AT THE TIME OF INSPECTION.

SUBGRADE / BASE REQUIREMENTS

IN NEW PLATS / SITES

- USE #304 AGGREGATE AS FOLLOWS:
- 4" MINIMUM FOR 4" WALKS
  - 6" MINIMUM FOR 6" WALKS
  - 8" MINIMUM FOR 8" WALKS

IN EXISTING PLATS / SITES

REMOVE EXISTING CONCRETE. COMPACTED #304 AGGREGATE SHALL BE USED AS NECESSARY TO PROVIDE A UNIFORM ACCEPTABLE SUBGRADE PRIOR TO PLACING CONCRETE TO ENSURE A UNIFORM CONCRETE THICKNESS.

# CONCRETE SIDEWALK DETAIL